

Coleman Creek Consulting, Inc.

**DRINKING WATER LEAD SAMPLING**  
OF  
**RAMSEY CAMPUS BUILDING 1**  
**711 RAMSEY STREET, GRANTS PASS, OREGON**  
FOR  
**SOUTHERN OREGON EDUCATION SERVICE DISTRICT**

**INTRODUCTION**


Coleman Creek Consulting, Inc. (CCC) was retained by the Southern Oregon Education Service District (SOESD) to perform representative lead drinking water sampling of the Ramsey Campus Building 2 at the above address. The purpose of the lead drinking water sampling was to determine the concentration of lead and copper in representative drinking water sources and compare with regulatory standards. In 2017, Education Service Districts were required to adopt a Healthy and Safe Schools Plan, including provisions for testing and reducing exposure to elevated levels of lead in water used for drinking and food preparation.

**LEAD DRINKING WATER SAMPLING REQUIREMENTS**

Guidelines for sampling lead in water were established by the Oregon Health Authority. Water sampling is to occur after water sits overnight in the pipes without being used, and must be sampled after a day occupied by students or building occupants. All water sources are to be sampled, with the exception of water used for heating, sanitation, irrigation, and science sinks for grades 6 and up with non-potable water signs. Initial testing is required to be performed by 2020, and every 6 years thereafter, according to a testing schedule determined by the Oregon Department of Education.

**DRINKING WATER SAMPLING**

David W. Fawcett of CCC visited the Ramsey Campus Building 1 on February 4, 2026. Mr. Fawcett collected a lead drinking water sample from the drinking water sources identified in the facility. See Site Sample Record Sheet (page 3) for a description of the drinking water sources sampled. See Drinking Water Sample Location Diagram in Appendix A for a visual review of all drinking water sample locations. The drinking water samples were collected in the early morning, ensuring that the sample source had not been in use since the previous day. The sample was placed in a cooler and transported to Neilson Research Corporation for lead analysis.



# Coleman Creek Consulting, Inc.

## **DRINKING WATER LEAD RESULTS AND TESTING SUMMARY SHEET**

The thirteen (13) drinking water samples collected were analyzed for lead using EPA Method 200.8. See Neilson Research Corporation Analytical Report in Appendix B. A Drinking Water Testing Summary Sheet (page 4) indicates the lead in drinking water concentrations for the thirteen (13) water samples were reported ranging from <0.5 to 2.95 parts per billion (ppb).


## **CONCLUSIONS**

Thirteen (13) drinking water samples were collected from drinking water sources at the Ramsey Campus Building 1 prior to use that day by building occupants, and after a day the facility was occupied. The lead concentrations reported were all below the 15 ppb lead action level in water.

## **RECOMMENDATIONS**

Coleman Creek Consulting, Inc. recommends future drinking water sampling at the Ramsay Campus Building 1 according to the schedule set out by the Oregon Department of Education. Coleman Creek Consulting, Inc. appreciates the opportunity to continue to perform environmental sampling and consulting services to Southern Oregon Education Service District.

David W. Fawcett  
Director of Consulting Services



# Coleman Creek Consulting, Inc.


## DRINKING WATER LEAD SAMPLE RECORD SHEET

FACILITY: Ramsey Campus Building 1  
ADDRESS: 711 Ramsey Street  
Grants Pass, Oregon

DATE: 02-04-26  
SAMPLER: David W. Fawcett

SAMPLE #	SOURCE DESCRIPTION	LOCATION	COLLECTION TIME
26-017G.1	Sink Faucet	Redwood Room	0656
26-017G.2	Sink Faucet	Child Restroom at Redwood Room	0657
26-017G.3	Sink Faucet	Break Room	0659
26-017G.4	Sink Faucet	Restroom Near Kitchen	0701
26-017G.5	Sink Faucet	Kitchen Prep Sink	0703
26-017G.6	Sink Faucet	Kitchen Handwash Sink	0704
26-017G.7	Sink Faucet	Handicap Restroom	0707
26-017G.8	Sink Faucet	Kid/Adult Restroom, Kid Sink	0709
26-017G.9	Sink Faucet	Kid/Adult Restroom, Adult Sink	0709
26-017G.10	Sink Faucet	Restroom at Cedar Room	0713
26-017G.11	Drinking Fountain	Hall Drinking Fountain, Left Side	0714
26-017G.12	Drinking Fountain	Hall Drinking Fountain, Right Side	0715
26-017G.13	Bottle Filler	Hall Drinking Fountain, Bottle Filler	0715

Note: New facility not previously sampled.



# Coleman Creek Consulting, Inc.

## DRINKING WATER TESTING SUMMARY SHEET

DISTRICT NAME: Southern Oregon Education Service District  
 DISTRICT ID#: 2025  
 SCHOOL NAME: Ramsey Campus  
 BUILDING NAME: Ramsey Campus Building 1  
 BUILDING ID#: 20250017

Sample Number	Fixture Location Description	Fixture ID#	Test Date	Test Result (ppb)	# Retest	Final Result (ppb)
26-017G.1	Bathroom Faucet	BF	02-04-26	0.663		0.663
26-017G.2	Bathroom Faucet	BF	02-04-26	<0.5		<0.5
26-017G.3	Breakroom Faucet	BF	02-04-26	2.95		2.95
26-017G.4	Bathroom Faucet	BF	02-04-26	1.33		1.33
26-017G.5	Kitchen Faucet	KF	02-04-26	<0.5		<0.5
26-017G.6	Kitchen Faucet	KF	02-04-26	0.883		0.883
26-017G.7	Kitchen Faucet	KF	02-04-26	<0.5		<0.5
26-017G.8	Bathroom Faucet	BF	02-04-26	<0.5		<0.5
26-017G.9	Bathroom Faucet	BF	02-04-26	0.536		0.536
26-017G.10	Bathroom Faucet	BF	02-04-26	<0.5		<0.5
26-017G.11	Drinking Fountain	DW	02-04-26	<0.5		<0.5
26-017G.12	Drinking Fountain	DW	02-04-26	<0.5		<0.5
26-017G.13	Bottle Filler	WB	02-04-26	<0.5		<0.5

Fixture ID Coding:

DW = Drinking Water Fountain WC = Water Cooler WB = Water Bottle Filler  
 CF = Classroom Faucet BF = Bathroom Faucet SF = Staff/Office Faucet  
 KF = Kitchen/Food Prep OS = Outside Spigot OT = Other (Specify)


\*\*Indicates fixture permanently removed from use

**APPENDIX A**

**DRINKING WATER SAMPLE LOCATION  
DIAGRAM**

**DRINKING WATER SAMPLE LOCATION DIAGRAM  
Ramsey Campus Building 1 - 711 Ramsey Avenue**

**Ramsey Ave**

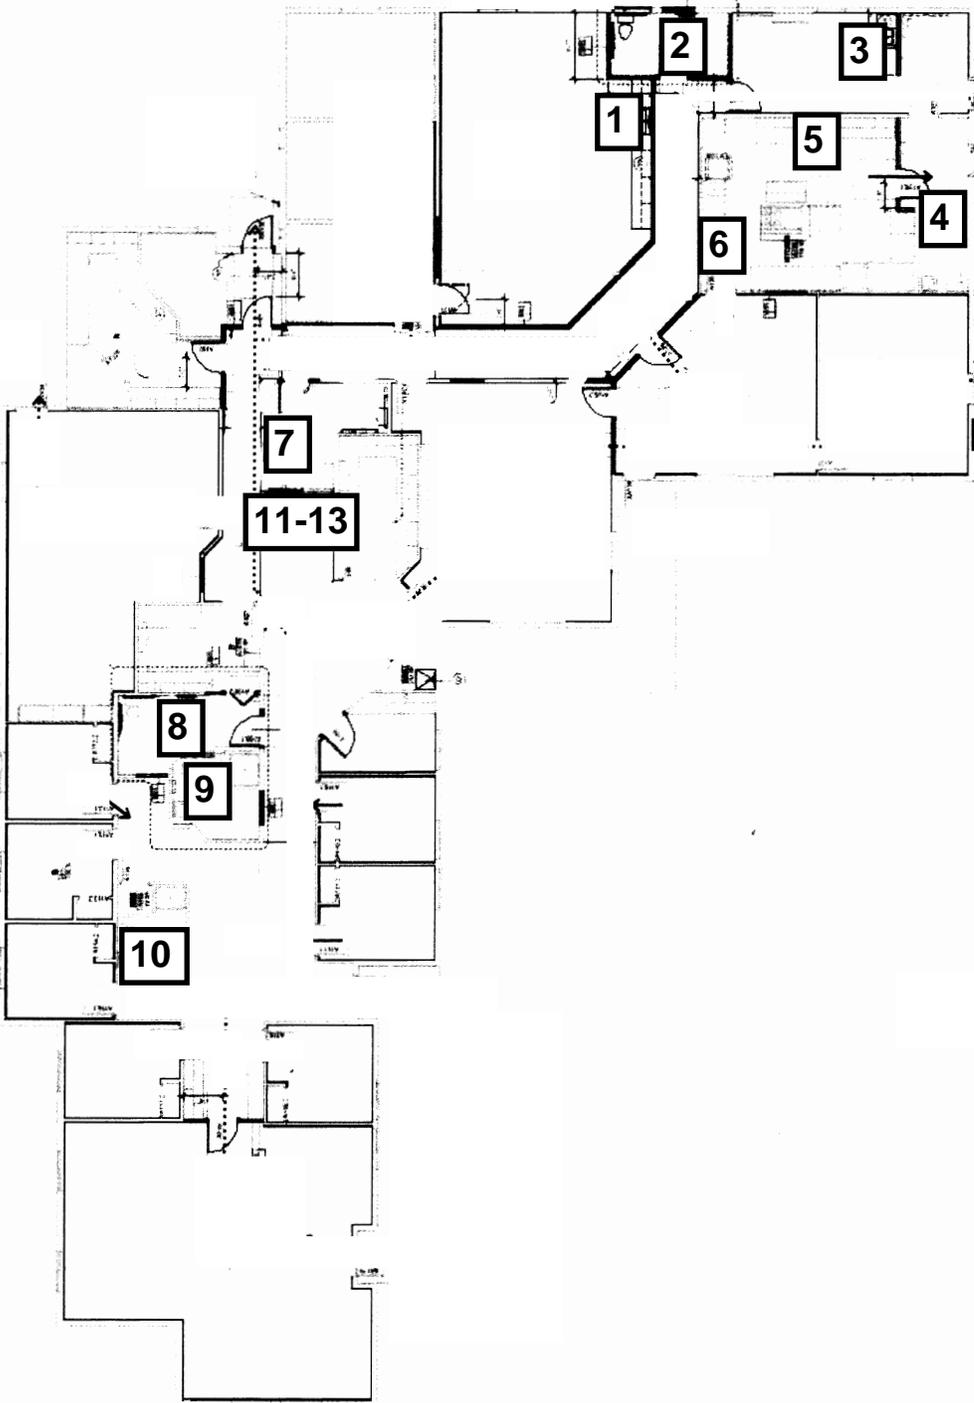

**LEGEND:**

**10** = Drinking Water Sample Location

**APPENDIX B**

**NEILSON RESEARCH CORPORATION  
ANALYTICAL REPORT**



Neilson Research Corporation  
245 S Grape St  
Medford, OR 97501  
TEL: (541) 770-5678 FAX: (541) 770-2901  
Website: www.nrclabs.com

February 10, 2026

Dave Fawcett  
Coleman Creek Consulting  
810 Leonard St  
Ashland, OR 97520  
TEL: (541) 535-7108  
FAX (541) 535-8795

RE: 26-017G Ramsey

Order No.: 26020105

Dear Dave Fawcett:

Neilson Research Corporation received 13 sample(s) on 2/4/2026 for the analyses presented in the following report.

The results relate only to the parameters tested or to the sample as received by the laboratory. This report shall not be reproduced except in full, without the written approval of Neilson Research Corporation. If you have any questions regarding these test results, please feel free to call.

Sincerely,  
Neilson Research Corporation

Tamra Schmedemann  
Director of Project Management  
245 S Grape St  
Medford, OR 97501



Original



Neilson Research Corporation  
245 S Grape St  
Medford, OR 97501  
TEL: (541) 770-5678 FAX: (541) 770-2901  
Website: [www.nrclabs.com](http://www.nrclabs.com)

## Case Narrative

WO#: 26020105  
Date: 2/10/2026

---

**CLIENT:** Coleman Creek Consulting

**Project:** 26-017G Ramsey

---

The analyses were performed according to the guidelines in the Neilson Research Corporation Quality Assurance Program. This report contains analytical results for the sample(s) as received by the laboratory.

Neilson Research Corporation certifies that this report is in compliance with the requirements of NELAP. No unusual difficulties were experienced during analysis of this batch except as noted below or qualified with data flags on the reports.

---

Original



Neilson Research Corporation  
 245 S Grape St  
 Medford, OR 97501  
 TEL: (541) 770-5678 FAX: (541) 770-2901  
 Website: www.nrclabs.com

# Analytical Report

WO#: 26020105  
 Date Reported: 2/10/2026

Coleman Creek Consulting  
 810 Leonard St  
 Ashland, OR 97520

**Lab Order:** 26020105  
**Received Date:** 2/4/2026 8:10:00 AM  
**Reported Date:** 2/10/2026 8:28:53 AM

Sample Information:

**Lab ID:** 26020105-01      Client Sample ID: 26-017G.1  
 Collection Date: 2/4/2026 6:56:00 AM      Collected By: Dave Fawcett  
 Matrix: Drinking Water      Sample Location: 26-017G.1

Trace Metals by EPA 200.8 ICP-MS							Analyst; PR		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	0.663		0.500	ppb	1	2/6/2026	15.0	A	

**Lab ID:** 26020105-02      Client Sample ID: 26-017G.2  
 Collection Date: 2/4/2026 6:57:00 AM      Collected By: Dave Fawcett  
 Matrix: Drinking Water      Sample Location: 26-017G.2

Trace Metals by EPA 200.8 ICP-MS							Analyst; PR		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	ND		0.500	ppb	1	2/6/2026	15.0	A	

**Lab ID:** 26020105-03      Client Sample ID: 26-017G.3  
 Collection Date: 2/4/2026 6:59:00 AM      Collected By: Dave Fawcett  
 Matrix: Drinking Water      Sample Location: 26-017G.3

Trace Metals by EPA 200.8 ICP-MS							Analyst; PR		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	2.95		0.500	ppb	1	2/6/2026	15.0	A	

<b>QUALIFIERS</b>	* Value exceeds Maximum or Minimum Contaminant Level.	C1 Sample container temperature is out of limit as specified at testcode
	DF Dilution Factor	E Value above quantitation range
	H Holding times for preparation or analysis exceeded	J Analyte detected below quantitation limits
	MI Recovery outside control limits due to Matrix Interference	ND Not Detected at the Reporting Limit
	R RPD outside accepted recovery limits	RL Reporting Limit

**NELAP** A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original



Neilson Research Corporation  
 245 S Grape St  
 Medford, OR 97501  
 TEL: (541) 770-5678 FAX: (541) 770-2901  
 Website: www.nrclabs.com

# Analytical Report

WO#: 26020105  
 Date Reported: 2/10/2026

Coleman Creek Consulting  
 810 Leonard St  
 Ashland, OR 97520

**Lab Order:** 26020105  
**Received Date:** 2/4/2026 8:10:00 AM  
**Reported Date:** 2/10/2026 8:28:53 AM

Sample Information:

**Lab ID:** 26020105-04      Client Sample ID: 26-017G.4  
 Collection Date: 2/4/2026 7:01:00 AM      Collected By: Dave Fawcett  
 Matrix: Drinking Water      Sample Location: 26-017G.4

Trace Metals by EPA 200.8 ICP-MS								Analyst:	PR
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	1.33		0.500	ppb	1	2/6/2026	15.0	A	

**Lab ID:** 26020105-05      Client Sample ID: 26-017G.5  
 Collection Date: 2/4/2026 7:03:00 AM      Collected By: Dave Fawcett  
 Matrix: Drinking Water      Sample Location: 26-017G.5

Trace Metals by EPA 200.8 ICP-MS								Analyst:	PR
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	ND		0.500	ppb	1	2/6/2026	15.0	A	

**Lab ID:** 26020105-06      Client Sample ID: 26-017G.6  
 Collection Date: 2/4/2026 7:04:00 AM      Collected By: Dave Fawcett  
 Matrix: Drinking Water      Sample Location: 26-017G.6

Trace Metals by EPA 200.8 ICP-MS								Analyst:	PR
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	0.883		0.500	ppb	1	2/6/2026	15.0	A	

<b>QUALIFIERS</b>	* Value exceeds Maximum or Minimum Contaminant Level.	C1 Sample container temperature is out of limit as specified at testcode
	DF Dilution Factor	E Value above quantitation range
	H Holding times for preparation or analysis exceeded	J Analyte detected below quantitation limits
	MI Recovery outside control limits due to Matrix Interference	ND Not Detected at the Reporting Limit
	R RPD outside accepted recovery limits	RL Reporting Limit

**NELAP** A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original



Neilson Research Corporation  
 245 S Grape St  
 Medford, OR 97501  
 TEL: (541) 770-5678 FAX: (541) 770-2901  
 Website: www.nrclabs.com

# Analytical Report

WO#: 26020105  
 Date Reported: 2/10/2026

Coleman Creek Consulting  
 810 Leonard St  
 Ashland, OR 97520

**Lab Order:** 26020105  
**Received Date:** 2/4/2026 8:10:00 AM  
**Reported Date:** 2/10/2026 8:28:53 AM

Sample Information:

**Lab ID:** 26020105-07      Client Sample ID: 26-017G.7  
 Collection Date: 2/4/2026 7:07:00 AM      Collected By: Dave Fawcett  
 Matrix: Drinking Water      Sample Location: 26-017G.7

Trace Metals by EPA 200.8 ICP-MS								Analyst:	PR
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	ND		0.500	ppb	1	2/6/2026	15.0	A	

**Lab ID:** 26020105-08      Client Sample ID: 26-017G.8  
 Collection Date: 2/4/2026 7:09:00 AM      Collected By: Dave Fawcett  
 Matrix: Drinking Water      Sample Location: 26-017G.8

Trace Metals by EPA 200.8 ICP-MS								Analyst:	PR
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	ND		0.500	ppb	1	2/6/2026	15.0	A	

**Lab ID:** 26020105-09      Client Sample ID: 26-017G.9  
 Collection Date: 2/4/2026 7:09:00 AM      Collected By: Dave Fawcett  
 Matrix: Drinking Water      Sample Location: 26-017G.9

Trace Metals by EPA 200.8 ICP-MS								Analyst:	PR
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	0.536		0.500	ppb	1	2/6/2026	15.0	A	

<b>QUALIFIERS</b>	* Value exceeds Maximum or Minimum Contaminant Level.	C1 Sample container temperature is out of limit as specified at testcode
	DF Dilution Factor	E Value above quantitation range
	H Holding times for preparation or analysis exceeded	J Analyte detected below quantitation limits
	MI Recovery outside control limits due to Matrix Interference	ND Not Detected at the Reporting Limit
	R RPD outside accepted recovery limits	RL Reporting Limit

**NELAP** A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original



Neilson Research Corporation  
 245 S Grape St  
 Medford, OR 97501  
 TEL: (541) 770-5678 FAX: (541) 770-2901  
 Website: www.nrclabs.com

# Analytical Report

WO#: 26020105  
 Date Reported: 2/10/2026

Coleman Creek Consulting  
 810 Leonard St  
 Ashland, OR 97520

**Lab Order:** 26020105  
**Received Date:** 2/4/2026 8:10:00 AM  
**Reported Date:** 2/10/2026 8:28:53 AM

Sample Information:

**Lab ID:** 26020105-10      Client Sample ID: 26-017G.10  
 Collection Date: 2/4/2026 7:13:00 AM      Collected By: Dave Fawcett  
 Matrix: Drinking Water      Sample Location: 26-017G.10

Trace Metals by EPA 200.8 ICP-MS								Analyst:	PR
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	ND		0.500	ppb	1	2/6/2026	15.0	A	

**Lab ID:** 26020105-11      Client Sample ID: 26-017G.11  
 Collection Date: 2/4/2026 7:14:00 AM      Collected By: Dave Fawcett  
 Matrix: Drinking Water      Sample Location: 26-017G.11

Trace Metals by EPA 200.8 ICP-MS								Analyst:	PR
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	ND		0.500	ppb	1	2/6/2026	15.0	A	

**Lab ID:** 26020105-12      Client Sample ID: 26-017G.12  
 Collection Date: 2/4/2026 7:14:00 AM      Collected By: Dave Fawcett  
 Matrix: Drinking Water      Sample Location: 26-017G.12

Trace Metals by EPA 200.8 ICP-MS								Analyst:	PR
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	ND		0.500	ppb	1	2/6/2026	15.0	A	

<b>QUALIFIERS</b>	* Value exceeds Maximum or Minimum Contaminant Level.	C1 Sample container temperature is out of limit as specified at testcode
	DF Dilution Factor	E Value above quantitation range
	H Holding times for preparation or analysis exceeded	J Analyte detected below quantitation limits
	MI Recovery outside control limits due to Matrix Interference	ND Not Detected at the Reporting Limit
	R RPD outside accepted recovery limits	RL Reporting Limit

**NELAP** A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original



Neilson Research Corporation  
 245 S Grape St  
 Medford, OR 97501  
 TEL: (541) 770-5678 FAX: (541) 770-2901  
 Website: www.nrclabs.com

# Analytical Report

WO#: 26020105  
 Date Reported: 2/10/2026

Coleman Creek Consulting  
 810 Leonard St  
 Ashland, OR 97520

**Lab Order:** 26020105  
**Received Date:** 2/4/2026 8:10:00 AM  
**Reported Date:** 2/10/2026 8:28:53 AM

Sample Information:


**Lab ID:** 26020105-13      Client Sample ID: 26-017G.13  
 Collection Date: 2/4/2026 7:15:00 AM      Collected By: Dave Fawcett  
 Matrix: Drinking Water      Sample Location: 26-017G.13

Trace Metals by EPA 200.8 ICP-MS						Analyst: PR			
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status	
Lead	ND		0.500	ppb	1	2/6/2026	15.0	A	

<b>QUALIFIERS</b>	* Value exceeds Maximum or Minimum Contaminant Level.	C1 Sample container temperature is out of limit as specified at testcode
	DF Dilution Factor	E Value above quantitation range
	H Holding times for preparation or analysis exceeded	J Analyte detected below quantitation limits
	MI Recovery outside control limits due to Matrix Interference	ND Not Detected at the Reporting Limit
	R RPD outside accepted recovery limits	RL Reporting Limit

**NELAP** A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original

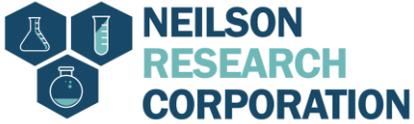

Neilson Research Corporation  
 245 S Grape St  
 Medford, OR 97501  
 TEL: (541) 770-5678 FAX: (541) 770-2901  
 Website: www.nrclabs.com

# QC SUMMARY REPORT

WO#: 26020105  
 10-Feb-26

**Client:** Coleman Creek Consulting  
**Project:** 26-017G Ramsey

**TestCode:** LEAD\_SCHOOLS

Sample ID: <b>MB-35648</b>	SampType: <b>MBLK</b>	TestCode: <b>LEAD_SCHO</b>	Units: <b>ppb</b>	Prep Date: <b>2/6/2026</b>	RunNo: <b>67358</b>						
Client ID: <b>PBW</b>	Batch ID: <b>35648</b>	TestNo: <b>E200.8</b>	<b>E200.8</b>	Analysis Date: <b>2/6/2026</b>	SeqNo: <b>1103322</b>						
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual

Lead ND 0.500

Sample ID: <b>LCS-35648</b>	SampType: <b>LCS</b>	TestCode: <b>LEAD_SCHO</b>	Units: <b>ppb</b>	Prep Date: <b>2/6/2026</b>	RunNo: <b>67358</b>						
Client ID: <b>LCSW</b>	Batch ID: <b>35648</b>	TestNo: <b>E200.8</b>	<b>E200.8</b>	Analysis Date: <b>2/6/2026</b>	SeqNo: <b>1103323</b>						
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual

Lead 97.2 0.500 100 0 97.2 85 115

Sample ID: <b>26020105-01AMS</b>	SampType: <b>MS</b>	TestCode: <b>LEAD_SCHO</b>	Units: <b>ppb</b>	Prep Date: <b>2/6/2026</b>	RunNo: <b>67358</b>						
Client ID: <b>26-017G.1</b>	Batch ID: <b>35648</b>	TestNo: <b>E200.8</b>	<b>E200.8</b>	Analysis Date: <b>2/6/2026</b>	SeqNo: <b>1103325</b>						
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual

Lead 96.7 0.500 100 0.663 96.0 70 130

Sample ID: <b>26020105-01AMSD</b>	SampType: <b>MSD</b>	TestCode: <b>LEAD_SCHO</b>	Units: <b>ppb</b>	Prep Date: <b>2/6/2026</b>	RunNo: <b>67358</b>						
Client ID: <b>26-017G.1</b>	Batch ID: <b>35648</b>	TestNo: <b>E200.8</b>	<b>E200.8</b>	Analysis Date: <b>2/6/2026</b>	SeqNo: <b>1103326</b>						
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual

Lead 95.6 0.500 100 0.663 95.0 70 130 96.7 1.08 20

**Qualifiers:** C1 Sample container temperature is out of limit as specified at testcode DF Dilution Factor H Holding times for preparation or analysis exceed  
 MI Recovery outside control limits due to Matrix Interference ND Not Detected at the Reporting Limit RL Reporting Limit

Original

Client Name: ColemanCreek

Work Order Number: 26020105

RcptNo: 1

Logged by: Ashley Spiegelberg	2/4/2026 8:10:00 AM	
Completed By: Eliza Sorenson	2/5/2026 10:27:31 AM	
Reviewed By: Tamra Schmedemann	2/10/2026 8:24:03 AM	

**Chain of Custody**

1. Is Chain of Custody complete? Yes  No  Not Present
2. How was the sample delivered? Client

**Log In**

3. Coolers are present? Yes  No  NA
4. Shipping container/cooler in good condition? Yes  No   
Custody seals intact on shipping container/cooler? Yes  No  Not Present  NA
- No. Seal Date: Signed By:
5. Was an attempt made to cool the samples? Yes  No  NA
6. Were all samples received at a temperature of >0° C to 6.0°C Yes  No  NA
7. Sample(s) in proper container(s)? Yes  No
8. Sufficient sample volume for indicated test(s)? Yes  No
9. Are samples (except VOA and ONG) properly preserved? Yes  No
10. Was preservative added to bottles? Yes  No  NA
11. Is the headspace in the VOA vials less than 1/4 inch or 6 mm? Yes  No  No VOA Vials
12. Were any sample containers received broken? Yes  No
13. Does paperwork match bottle labels? Yes  No   
(Note discrepancies on chain of custody)
14. Are matrices correctly identified on Chain of Custody? Yes  No
15. Is it clear what analyses were requested? Yes  No
16. Were all holding times able to be met? Yes  No   
(If no, notify customer for authorization.)

**Special Handling (if applicable)**

17. Was client notified of all discrepancies with this order? Yes  No  NA

Person Notified:	<input type="text"/>	Date:	<input type="text"/>
By Whom:	<input type="text"/>	Via:	<input type="checkbox"/> eMail <input type="checkbox"/> Phone <input type="checkbox"/> Fax <input type="checkbox"/> In Person
Regarding:	<input type="text"/>		
Client Instructions:	<input type="text"/>		

18. Additional remarks:

**Cooler Information**

Cooler No	Temp °C	Condition	Seal Intact	Seal No	Seal Date	Signed By
-----------	---------	-----------	-------------	---------	-----------	-----------

Section A Required Client Information	Section B Required Project Information	Section C Invoice Information	Section D Rush Status (Subject to Scheduling)																																																																																																																								
Company: Coleman Creek Consulting	Project Name: <u>Ramsey</u>	Attention:	<input checked="" type="checkbox"/> Standard: 10 Business Days																																																																																																																								
Address: 810 Leonard St Ashland, OR 97520	Project Number: <u>26-0176</u>	Company Name:	<input type="checkbox"/> Priority: 5 Business Days (List x 1.50)																																																																																																																								
Email: <a href="mailto:fawbro@ccountry.net">fawbro@ccountry.net</a>	Report To: Dave Fawcett	Address:	<input type="checkbox"/> Express: 3 Business Days (List x 1.75)																																																																																																																								
Phone: Fax:	Copy To:	P.O. #	<input type="checkbox"/> Rush: 2 Business Days (List x 2.00)																																																																																																																								
Collected By (Print): <u>Dave Fawcett</u>	<table border="1" style="width: 100%; border-collapse: collapse;"> <thead> <tr> <th colspan="10">Analysis Requested</th> </tr> <tr> <th>No. of Containers</th> <th>Total Lead</th> <th></th><th></th><th></th><th></th><th></th><th></th><th></th><th></th> </tr> </thead> <tbody> <tr> <td style="text-align: center;">1</td> <td style="text-align: center;">X</td> <td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td> </tr> <tr> <td style="text-align: center;">1</td> <td style="text-align: center;">X</td> <td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td> </tr> <tr> <td style="text-align: center;">1</td> <td style="text-align: center;">X</td> <td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td> </tr> <tr> <td style="text-align: center;">1</td> <td style="text-align: center;">X</td> <td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td> </tr> <tr> <td style="text-align: center;">1</td> <td style="text-align: center;">X</td> <td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td> </tr> <tr> <td style="text-align: center;">1</td> <td style="text-align: center;">X</td> <td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td> </tr> <tr> <td style="text-align: center;">1</td> <td style="text-align: center;">X</td> <td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td> </tr> <tr> <td style="text-align: center;">1</td> <td style="text-align: center;">X</td> <td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td> </tr> <tr> <td style="text-align: center;">1</td> <td style="text-align: center;">X</td> <td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td> </tr> <tr> <td style="text-align: center;">1</td> <td style="text-align: center;">X</td> <td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td> </tr> </tbody> </table>		Analysis Requested										No. of Containers	Total Lead									1	X									1	X									1	X									1	X									1	X									1	X									1	X									1	X									1	X									1	X									<input type="checkbox"/> Rush: 1 Business Day (List x 2.50)
Analysis Requested																																																																																																																											
No. of Containers			Total Lead																																																																																																																								
1	X																																																																																																																										
1	X																																																																																																																										
1	X																																																																																																																										
1	X																																																																																																																										
1	X																																																																																																																										
1	X																																																																																																																										
1	X																																																																																																																										
1	X																																																																																																																										
1	X																																																																																																																										
1	X																																																																																																																										
Collected By (Sign): <u>[Signature]</u>			<input type="checkbox"/> Rush: Same Day (List x 3.00)																																																																																																																								
Email Report <input checked="" type="checkbox"/> Mail Report <input type="checkbox"/> Fax Report <input type="checkbox"/>			Authorized <input type="checkbox"/> Yes <input type="checkbox"/> No																																																																																																																								

Section E Sample Information					Analysis Requested										Section G Lab Use Only				
Sample ID	Comp/Grab	Matrix*	Date Collected	Time Collected	No. of Containers	Total Lead											Remarks / Field Data	NRC Sample # (Lab Use Only)	(Lab)
<u>26-0176.1</u>	<u>Grab</u>	<u>DW</u>	<u>2-4-26</u>	<u>0656</u>	1	X												<u>01</u>	
<u>2</u>				<u>0657</u>	1	X												<u>02</u>	
<u>3</u>				<u>0659</u>	1	X												<u>03</u>	
<u>4</u>				<u>0701</u>	1	X												<u>04</u>	
<u>5</u>				<u>0703</u>	1	X												<u>05</u>	
<u>6</u>				<u>0704</u>	1	X												<u>06</u>	
<u>7</u>				<u>0707</u>	1	X												<u>07</u>	
<u>8</u>				<u>0709</u>	1	X												<u>08</u>	
<u>9</u>				<u>0709</u>	1	X												<u>09</u>	
<u>10</u>				<u>0713</u>	1	X												<u>10</u>	

\*Matrix: DW - Drinking Water WW - Wastewater W - Water S - Soil/Solid SL - Sludge O - Oil WP - Wipe OT - Other

Section F		Section G	
Relinquish/Receive	Sign	Lab Use Only	
		Temp: <u>Amb</u>	IR Therm ID: <u>NA</u>
Relinquished By: <u>[Signature]</u>	Print: <u>David Fawcett</u>	≤6°C: <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No	Received on Ice: <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No
Received By:	Date: <u>2-4-26</u>	Number of Bottles Received:	pH Checked: <u>-</u>
Relinquished By:	Time: <u>0810</u>	COC Seals Intact: <input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> NA	Field Blank Included: <input type="checkbox"/> Yes <input type="checkbox"/> No
Received By:		Received Via <input type="checkbox"/> UPS <input type="checkbox"/> FedEX <input type="checkbox"/> Other <input checked="" type="checkbox"/> Hand	
Relinquished By:		Payment: <input checked="" type="checkbox"/> Invoice <input type="checkbox"/> Cash <input type="checkbox"/> VISA, M/C <input type="checkbox"/> Check # _____ Amount _____	
Received By Laboratory: <u>[Signature]</u>	Print: <u>Ashley Spiegelburg</u>		
	Date: <u>2/4/26</u>		
	Time: <u>8:10</u>		

This Chain of Custody is a LEGAL DOCUMENT and must be filled out accurately.

Section A Required Client Information	Section B Required Project Information	Section C Invoice Information	Section D Rush Status (Subject to Scheduling)
Company: Coleman Creek Consulting	Project Name: <u>Ramsey</u>	Attention:	<input checked="" type="checkbox"/> Standard: 10 Business Days
Address: 810 Leonard St	Project Number: <u>26-017G</u>	Company Name:	<input type="checkbox"/> Priority: 5 Business Days (List x 1.50)
Ashland, OR 97520	Report To: Dave Fawcett	Address:	<input type="checkbox"/> Express: 3 Business Days (List x 1.75)
Email: <a href="mailto:fawbro@ccountry.net">fawbro@ccountry.net</a>	Copy To:	PO #:	<input type="checkbox"/> Rush: 2 Business Days (List x 2.00)
Phone: 541-535-7108 Fax: 541-535-8795			<input type="checkbox"/> Rush: Same Day (List x 3.00)
Collected By (Print):			Authorized <input type="checkbox"/> Yes <input type="checkbox"/> No
Collected By (Sign):			
Email Report <input type="checkbox"/> Mail Report <input type="checkbox"/> Fax Report <input type="checkbox"/>			

Section E Sample Information						Analysis Requested										NRC Workorder # (Lab Use Only) <u>26020105</u>			
Sample ID	Comp/Grab	Matrix*	Date Collected	Time Collected	No. of Containers													Remarks / Field Data	NRC Sample # (Lab Use Only)
<u>26-017G.11</u>	<u>Grab</u>	<u>DW</u>	<u>2-4-26</u>	<u>0714</u>	<u>1</u>														<u>11</u>
<u>12</u>	<u>↓</u>	<u>↓</u>	<u>↓</u>	<u>0714</u>	<u>1</u>														<u>12</u>
<u>13</u>	<u>↓</u>	<u>↓</u>	<u>↓</u>	<u>0715</u>	<u>1</u>														<u>13</u>

\*Matrix: DW - Drinking Water WW - Wastewater W - Water S - Soil/Solid SL - Sludge O - Oil WP - Wipe OT - Other

Section F Relinquish/Receive		Sign	Print	Date	Time
Relinquished By:	<u>[Signature]</u>	<u>David Fawcett</u>	<u>David Fawcett</u>	<u>2-4-26</u>	<u>0812</u>
Received By:					
Relinquished By:					
Received By:					
Relinquished By:	<u>[Signature]</u>	<u>Ashley Spiegelberg</u>	<u>Ashley Spiegelberg</u>	<u>2/4/26</u>	<u>8:12</u>
Received By Laboratory:					

Section G Lab Use Only	
Temp:	<u>Amb</u>
4°C +/- 2°C:	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <u>NA</u>
Received on Ice:	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No
Number of Bottles Received:	
pH Checked:	<input checked="" type="checkbox"/>
COC Seals Intact:	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <u>NA</u>
Field Blank Included:	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No

Received Via <input type="checkbox"/> UPS <input type="checkbox"/> FedEX <input type="checkbox"/> Other <input checked="" type="checkbox"/> Hand
Payment: <input checked="" type="checkbox"/> Invoice <input type="checkbox"/> Cash <input type="checkbox"/> VISA, M/C <input type="checkbox"/> Check # _____ Amount _____